



PORO POINT MANAGEMENT CORPORATION

A Member of the Bases Conversion and Development Authority Group



PUBLIC BIDDING OF THE CONTRACT FOR THE 1) SUPPLY, DELIVERY, INSTALLATION, TESTING AND COMMISSIONING OF TWO (2) UNITS BRAND NEW CONSTANT CURRENT REGULATOR (CCR) AND 2) REHABILITATION, REPAIR AND REPLACEMENT OF DEFECTIVE PARTS, TESTING AND COMMISSIONING OF MAIN CONTROL DESK

To All Prospective Bidders:

SUPPLEMENTAL/BID BULLETIN NO. 1

In accordance with the provision stated in the Bidding Documents of the Public Bidding of the Contract for the 1) Supply, Delivery, Installation, Testing and Commissioning of two (2) units brand new Constant Current Regulator (CCR) and 2) Rehabilitation, Repair and Replacement of defective parts, Testing and Commissioning of Main Control Desk, Supplemental/Bid Bulletin No. 1 is hereby issued to provide additional information, necessary corrections and amendments in the Bidding Documents:

- Page 35, Checklist of Technical and Financial Documents, Technical Documents (e) shall be amended to read as follows:

| | |
|--|---|
| e. Conformity with the Technical Specifications, which may include production/delivery schedule, manpower requirements, and/or after-sales/parts, if applicable; and | Please use Form 5 attached as Annex "A" of the Supplemental/Bid Bulletin No. 1 |
|--|---|

- Pages 46-48, Form 5 (Conformity with the Technical Specifications), shall be amended. A copy of the amended Form 5 (Conformity with the Technical Specifications), is hereto marked and attached as **Annex "A."**
- The following responses of the Bids and Awards Committee to queries raised by the prospective bidders are made an integral part of this Supplemental/Bid Bulletin.

| Questions | Answer of the Bids and Awards Committee |
|--|--|
| Under ITB Clause 21.2 of the Bid Data Sheet, are the submission of the additional contract documents need to be submitted during post-qualification? | These are not required to be submitted during post-qualification. These are documents that need to be submitted before signing the contract. Winning bidder will be properly notified when to submit the contract documents. |
| Are we allowed to conduct site inspection? | Bidders may conduct inspection from Mondays to Fridays, from 8:00 AM to 5:00 PM. |
| Per your specification on the Maximum Output Voltage of CCR you required 758V with control voltage of 20vdc - 60 vdc, is | Your proposed 757 V with control voltage of 24 vdc to 60 vdc is within the range of voltages, but the existing schematic diagram of the CCR has a 20Vdc |




PORO POINT MANAGEMENT CORPORATION

A Member of the Bases Conversion and Development Authority Group




757V with control voltage of 24 vdc to 60 vdc acceptable since it is within the range and the existing Remote Control is 48 vdc only.

output. Please see the schematic diagram below for your reference or you may check or verify at site during the site inspection if your proposed unit is compatible to the whole system.

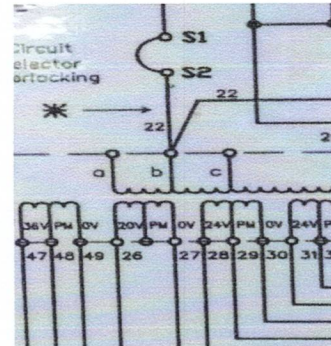

Per your specification you required 5 steps brightness control, can we offer up 7 steps Brightness control (can be set to Step 1 to 5 Brightness Control at the Remote control).

The existing design of the MCD selector switches only have five (5) steps control. The Supplier may offer more superior specifications at no additional cost to PPMC. Please see below the picture of the existing selector switches for your reference or you may check or verify at site during the site inspection if your proposed unit is compatible to the whole system.

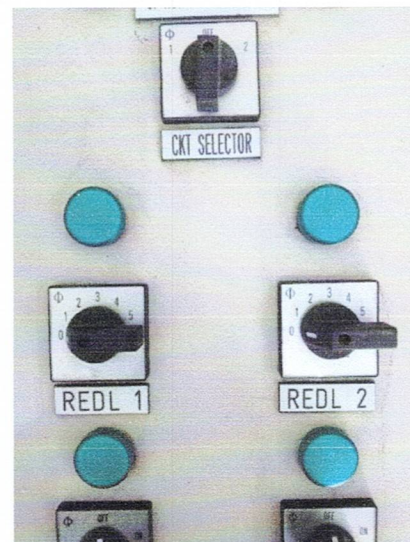




PORO POINT MANAGEMENT CORPORATION

A Member of the Bases Conversion and Development Authority Group



With regards to input of CCR, per your specs for 5kVA is 24 A, Each manufacturer has its own standard, can we offer 5 KVa CCR up to 26A input current.

The Supplier may offer more superior specifications at no additional cost to PPMC, but the maximum output voltage must be 758V and the constant current output is 6.6A. Please see below the picture of the existing CCR specifications for your reference or you may check or verify at site during the site inspection if your proposed unit is compatible to the whole system.

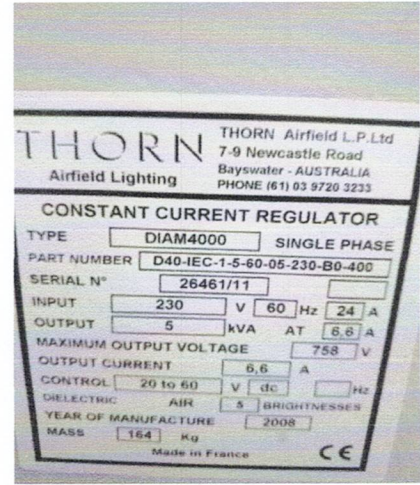

On the form with Notarization can we use "Appointment No." for the notarial seal of the document which is same as Serial No. of Commission as this is the standards on some notarization.

Rule VIII, Section 2 of the Administrative Matter (AM) No. 02-8-13-SC of the Supreme Court of the Philippines states that, viz:

“Sec 2. Contents of the Concluding Part of the Notarial Certificate – The notarial certificate shall include the following:

- a. The name of the notary public as exactly indicated in the commission;
- b. The serial number of the commission of the notary public;
- c. The words “Notary Public” and the province or city where the notary public is commission, the expiration date of the commission, the office address of the notary public; and
- d. The roll of attorney’s number, the professional tax receipt number and the place and date of issuance thereof, and the IBP membership number” (*Underscoring supplied for emphasis*)



PORO POINT MANAGEMENT CORPORATION

A Member of the Bases Conversion and Development Authority Group



This Supplemental/ Bid Bulletin No. 1 shall form part and made integral to the Bidding Documents.


For the guidance and information of all concerned.


Issued this 24th day of February 2025.


BIDS AND AWARDS COMMITTEE FOR THE PROCUREMENT OF GOODS


MS. ELIZA M. MACONOCIDO
Vice Chairperson


ENGR. CERILA A. CORPUZ
Member, BAC


MS. JOSEFA CATHERINE T. BADA
Member, BAC


ATTY. ANNA TERIS D. CO
Member, BAC


MR. FRANKLIN C. VILLAREAL
Member, BAC

MR. JOHN ROEL B. DELUYAS
Member, BAC


MS. MARIA VICTORIA REDEMPTA DE GUZMAN-SORIANO
Chairperson

CONFORMITY WITH TECHNICAL SPECIFICATIONS

| | | SUPPLIER'S COMPLIANCE WITH TECHNICAL SPECIFICATIONS | |
|--|------------------------------|---|--|
| | | Bidders must state here either "Comply" or "Not Comply" against each of the individual parameters of each Specification stating the corresponding performance parameter of the equipment offered. Statements of "Comply" or "Not Comply" must be supported by evidence in a Bidders Bid and cross-referenced to that evidence. Evidence shall be in the form of manufacturer's un-amended sales literature, unconditional statements of specification and compliance issued by the manufacturer, samples, independent test data etc., as appropriate. A statement that is not supported by evidence or is subsequently found to be contradicted by the evidence presented will render the Bid under evaluation liable for rejection. A statement either in the Bidders statement of compliance or the supporting evidence that is found to be false either during Bid evaluation, post-qualification or the execution of the Contract may be regarded as fraudulent and render the Bidder or supplier liable for prosecution subject to the provisions of ITB Clause 4. | |
| ITEM | SPECIFICATIONS | STATEMENT OF COMPLIANCE (Please indicate "COMPLY" or "NOT COMPLY.") | SUPPLIER'S OFFERED SPECIFICATIONS |
| CONSTANT CURRENT REGULATOR (CCR) MINIMUM SPECIFICATIONS | | | |
| • Phase | Single Phase | | |
| • Degree of Mechanical Protection | IP21 | | |
| • Input | 230 VAC, 60Hz., 24 A | | |
| • Output | 5 kVA at 6.60 A | | |
| • Maximum Output Voltage | 758 V | | |
| • Output Current | 6.60 A | | |
| • Control | 20-60 Vdc | | |
| • Current Protection | Open Circuit and Overcurrent | | |
| • Brightness | 5 steps brightness control | | |
| • Other Protective Device | Surge/Lightning Arrester | | |

| | | | |
|--------------------------|--|--|--|
| | Proceed. | | |
| SPECIAL PROVISION | <p>Bidder must have been engaged in the sale and service maintenance of equipment for Airfield Ground Lighting System in good standing in the Philippines for at least five (5) years from the date of the invitation to bid. The equipment brand must have good quality track record and must have been commercially sold and distributed in the Philippines for at least five (5) years from the date of the Invitation to Bid.</p> | | |
| OTHERS | <p>After Sales Service and Support during the warranty period, all reported defects shall be completely/satisfactorily repaired/replaced by all the winning bidder/supplier within 72 hours after receipt of a verbal and/or written notice from the procuring entity.</p> <p>After the warranty period, spare parts or components shall be supplied as promptly as possible, but in any case, within one month upon placing the order.</p> <p>Spare parts shall be available in</p> | | |

| | | | |
|---|---|--|--|
| | | | |
| MAIN CONTROL DESK MINIMUM SPECIFICATIONS | | | |
| <ul style="list-style-type: none"> Rehabilitation, Repair and Replacement of defective parts, Testing and Commissioning of Main Control Desk <p>To provide/supply the Power Supply</p> | | | |
| SERVICES | <p>The supplier shall provide the following:</p> <p>1) Supply, Delivery, Installation, Testing and Commissioning of two (2) units brand new Constant Current Regulator (CCR) and 2) Rehabilitation, Repair and Replacement of defective parts, Testing and Commissioning of Main Control Desk on site to conform with the whole Airfield Ground Lighting System, Operation and Maintenance Training to PPMC personnel, CAAP personnel and end user.</p> | | |
| WARRANTY | One (1) Year after acceptance by the Procuring Entity | | |
| DELIVERY | Within One Hundred Eighty (180) Calendar Days from Receipt of the Notice to | | |

| | | | |
|--|------------------------|--|--|
| | the Philippine market. | | |
|--|------------------------|--|--|

THE SUPPLIER MAY OFFER MORE SUPERIOR SPECIFICATIONS AT NO ADDITIONAL COST TO PPMC.

I hereby undertake to comply with all the above requirements.

Bidder's Representative : _____
Printed Name and Signature of Bidder's Representative/Authorized Signatory

Designation : _____

Date : _____